



The PVC used in the manufacture of our splash fill bars can soften and become deformed at temperatures above 140F. Under certain storage conditions it is possible to exceed this temperature with sunlight. To avoid this, the following procedure must be adhered to:

- A.) **The splash bar skids must not be double stacked.** Excessive weight on the bars combined with the heat from sun light could cause the bars to warp. All skids must be fully supported on flat level ground.
- B.) **All skids should be stored in an area where impact damage is not likely to occur and adequate protection is afforded against dirt and other debris.**
- C.) **All skids requiring storage more than 4 weeks should be covered.** Ideally these covers should be double sided such as a white on black. The white side, facing out, is used to reflect light away. Clear covers are prohibited. Black is not recommended since black will absorb heat and if the covers come in direct contact with the media, this heat can be quickly transferred to the media. Covers can not be wrapped tightly around the media. There should be at least a 6" air gap between the cover and top of media. The ends of the cover should be securely anchored on all sides with at least a 12" air gap at the bottom. These covers should provide shading while allowing air to pass through to prevent heat from building up. See Drawing CTPGA-007 for details.
- D.) **Skids should be checked once a week.** It is very possible that the covers can become loose over time due to wind or rain. A check of the stored area should be done to make any minor repairs to the cover or to restack any bars that could have come loose.

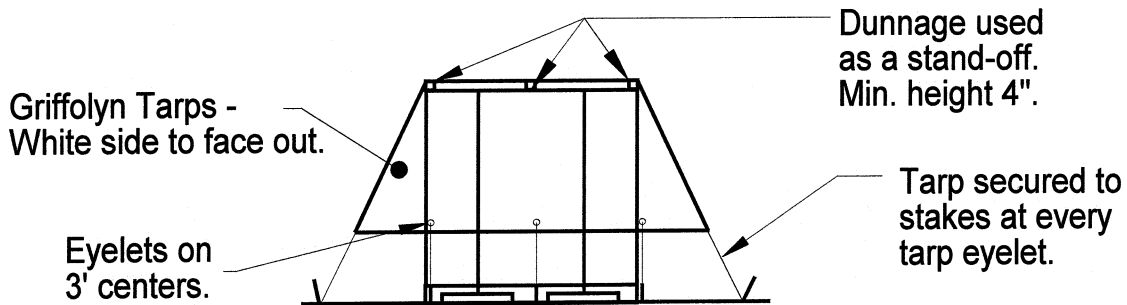


Front Elevation - Typical Single Row

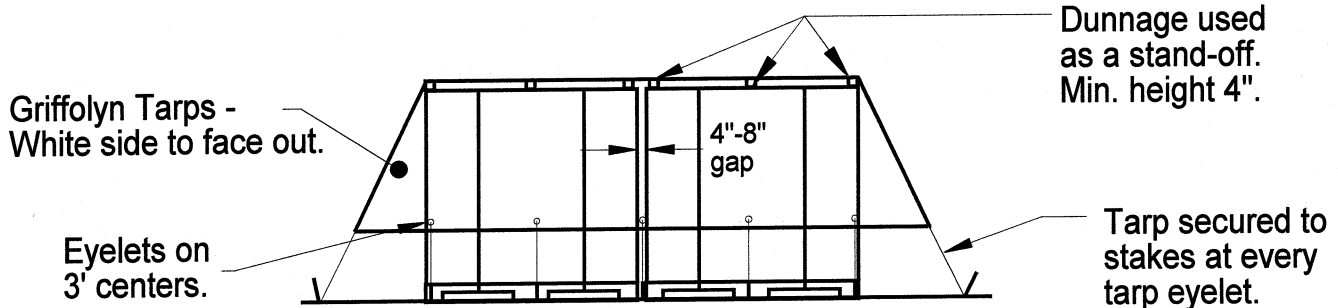

Front Elevation - Typical Double Row

Notes:

- Only acceptable tarps, Griffolyn models T-65, T-85, or T-105.
- Griffolyn tarps manufactured by:
 - Reef Industries, Inc.
 - P.O. Box 750250
 - Houston, TX 77275-0250
 - Tel: 1-800-231-6074

 BRENTWOOD INDUSTRIES, INC.		P.O. Box 605 Reading, PA 19603	
SCALE	NTS	DRAWN BY	RJA
DATE	1/22/96	APPROVED BY	<i>RJA</i>
TITLE General Arrangement of Fill Pallets for Extended Outside Storage.			
FILE NO.	storage.skd	DRAWING NO./DIE NO.	CTPGA-007
			REV.